


This diagram is for illustrative purposes only, and should not be relied upon for installation.

**Service Drop (no existing UL standard)**

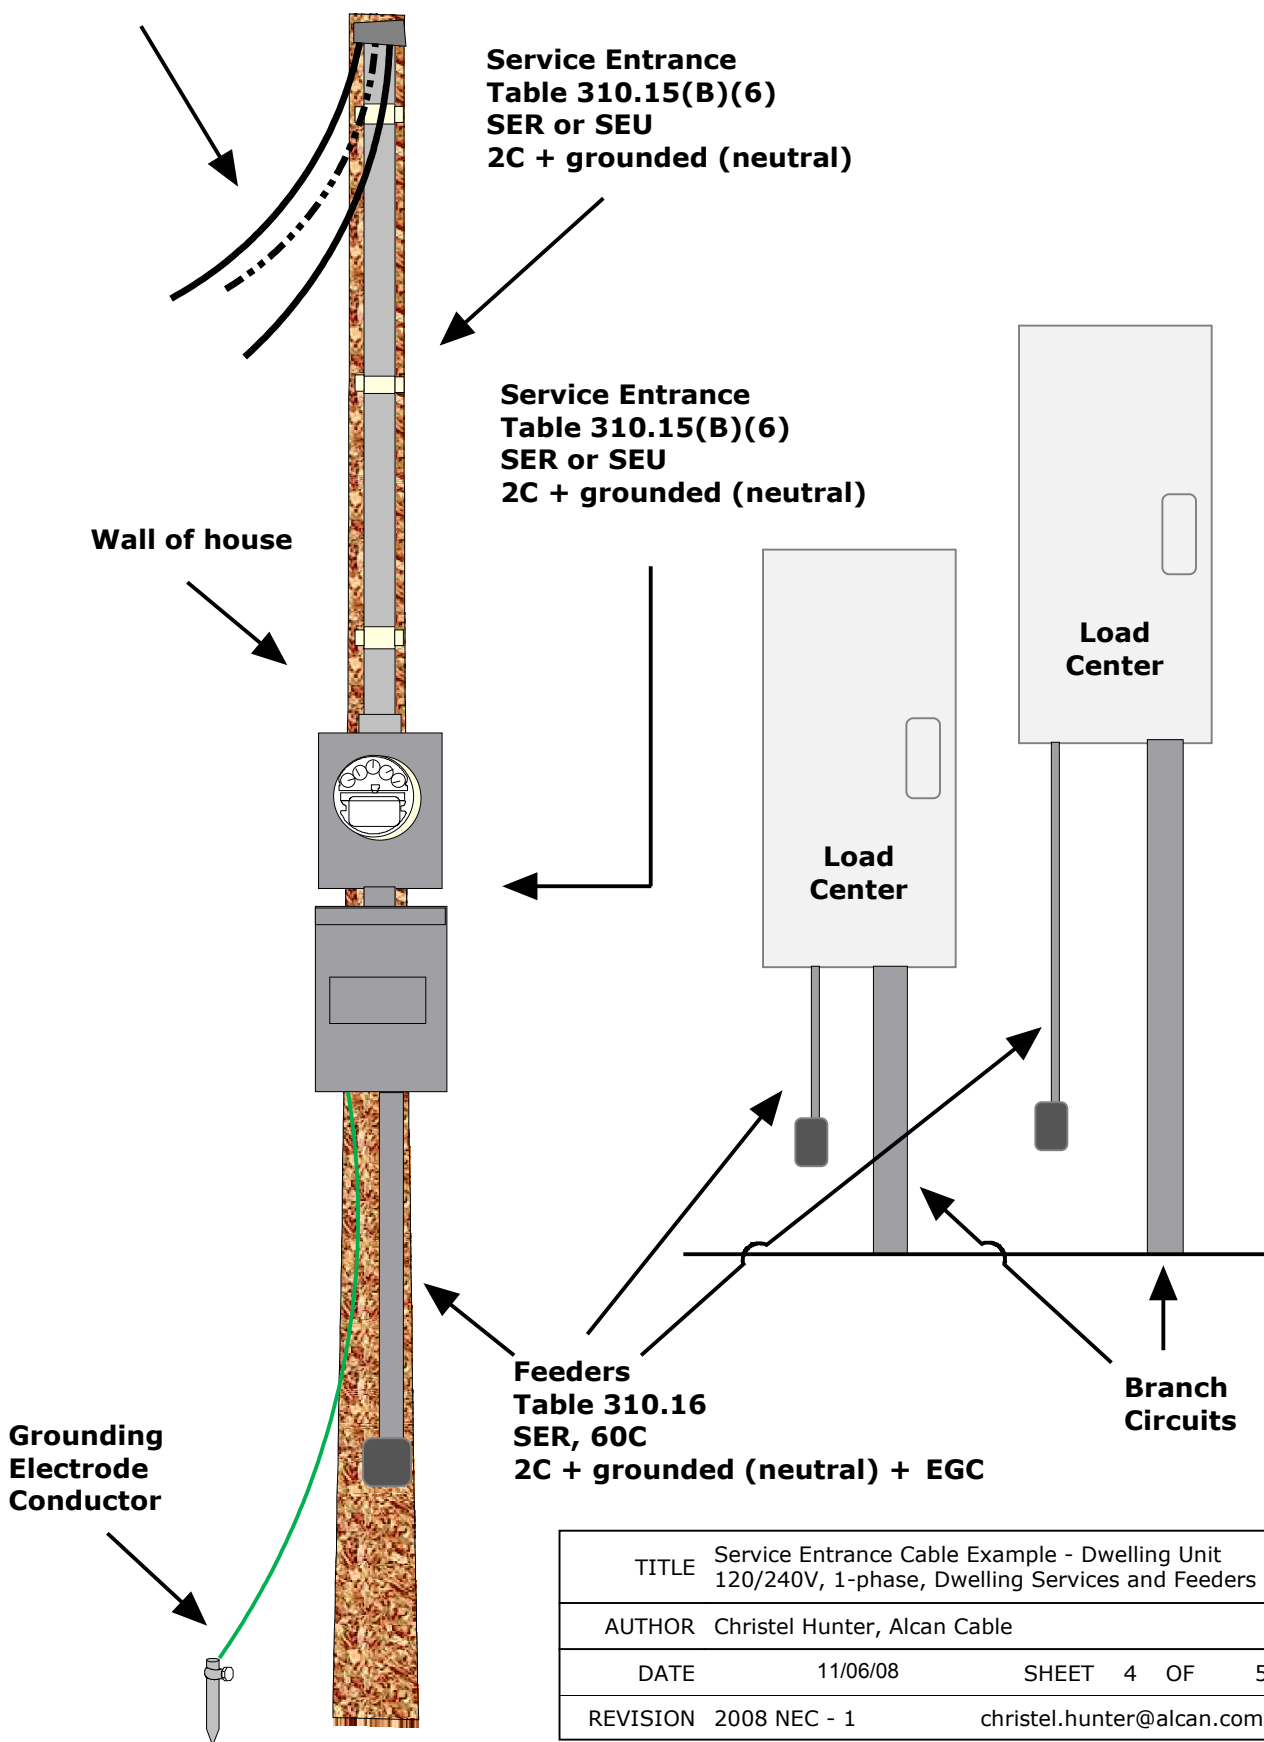

TITLE	Service Entrance Cable Example - Dwelling Unit 120/240V, 1-phase, Dwelling Services and Feeders		
AUTHOR	Christel Hunter, Alcan Cable		
DATE	11/06/08	SHEET	4 OF 5
REVISION	2008 NEC - 1	christel.hunter@alcan.com	

Check with your local Authority Having Jurisdiction to determine if your installation meets the applicable codes.